



Main applications

- Gate motors
- Conveyor belt motors

Main features

- Solid state contactor for forward/reverse control for 3-phase motors up to 4 KW – 400 VAC.
- Nominal voltage max.: 400Vac
- Non-repetitive voltage up to 900 Vp
- Input control: 5...32 VDC
- Isolation (input/output) 4000 VAC
- IP20 direct contact protection
- LED indication of motor direction
- Integrated voltage transient protection
- In Conformity with EN60947-4-2 and UL508

PROFILE

The controller is a thyristor-type power solid state relay designed to control a 3-phase asynchronous motor in two directions.

There are two control signals and an internal logic that permits selection of only one direction at a time.

A green LED indicates forward; a red LED indicates reverse.

The power thyristors are protected against excessive voltage fluctuation by varistors and RC snubbers incorporated in the module.

It is advisable to install three high-speed fuses between the 3-phase line and the controller.

WARNING: The GI models must be used in conjunction with an appropriate heatsink (Accessory).

Installation must precisely observe the warnings contained in the installation notes.

TECHNICAL DATA

GENERAL FEATURES

Category of use: AC53a
 Nominal voltage (Ue): 400Vac (max. range 24...440Vac)
 Nominal frequency: 50/60Hz
 Peak voltage: 900Vp
 Critical dV/dt OFF-state: 500V/μs
 I_{2t} for fusion t = 20 ms: 1120 A²s
 Leakage current OFF: max 5 mA @ 380Vac
 Activation time (max.): 20ms
 Deactivation time (max.): 60ms
 Inversion time: 100ms
 Potential drop at rated current: ≤ 1,4Vrms
 IP20 protection
 Weight: 300g

CONTROL INPUT

Voltage of command circuit (Uc): 5...32Vdc
 Activation voltage: >4.5Vdc
 Deactivation voltage: <3Vdc
 Max. reverse voltage: - 40 Vdc
 Max. input: 21 mA @ 5 Vdc
 Max. input: 29 mA @ 32 Vdc

OUTPUT

Output motor
 Nominal current (I_{max}): AC53a: 3x6 A

INSULATION

Nominal insulation voltage to ground 2500Vac

Nominal voltage from control and output: 4000Vac

AMBIENTAL CONDITION

- Working temperature: -20°C...50°C
- Max. relative humidity: 50% a 40°C
- Max. installation altitude: 1000 slm
- Pollution level : 3
- Storage temperature: -20...85°C
- Class: A (industrial device)
- Suitable for use in pollution degree 2 environmental

THERMAL FEATURES

Junction time: ≤ 125°C
 R_{th} junction/housing = 1.5 K/W

SOLID STATE RELAY DISSIPATED POWER CALCULATION

Three-phase relay
 $P_d = 2 \times 1,6 \times I_{RMS} [W]$
 I_{RMS} = three-phase load current

HEATSINK THERMAL RESISTANCE CALCULATION

$R_{th} = (90^\circ C - T_{amb.max}) / P_d$
 P_d = dissipated power
 T_{amb.max} = max air temperature inside the electrical cabinet.
 Use a heatsink with thermal resistance inferior to the calculated one (R_{th})

- A simple heatsink is a metallic plate of dimensions 300x380x2mm

INSTALLATION NOTES

Use the high speed fuses specified in the catalog according to the connection example provided.

Applications with solid state power units must also include an automatic safety switch to cut out the load power line. Protect the solid state relay by using an appropriate heat sink (accessory).

The heat sink must be sized according to room temperature and load current (see the technical documentation).

Procedure for mounting on heat sink:

The module-heat sink contact surface must have a maximum planarity error of 0.05mm. and maximum roughness of 0.02mm.

The fastening holes on the heat sink must be threaded and countersunk.

Spread 4 gram of thermoconductive silicone (we recommend DOW CORNING 340 HeatSink) on the dissipative metal surface of the module.

The surfaces must be clean and there must be no impurities in the thermoconductive paste.

Use 4 M4x10 or M5 x 10 screws with

flexible washer for attachment.

Alternately tighten the fastening screws until reaching a torque of 0.60Nm.

Wait 30 minutes for any excess paste to drain.

Alternately tighten the four fastening screws until reaching a torque of 1.2 Nm for the M4 screws and 1.5 Nm for the M5 screws.


It is advisable to make random checks of correct installation by disassembling the module and checking that there are no air bubbles under the copper plate. Install the units cantilevered to the panel so that air can flow vertically over the heatsink without obstructions.

- Maximum surrounding air temperature 40°C (for UL)
- Open type equipment
- Suitable for use on a circuit capable of delivering not more than 5 KA RMS symmetrical Amperes, 600Vac, when protected by listed cartridge fuses, nonrenewable (JDDZ), 15A class RK5, time delay fuse, or equivalent.
- Use fuses only to protect the GI device

LIMITS OF USE


- dissipation of thermal power of device with restrictions on temperature of installation site.
- requires exchange with outside air or an air conditioner to transfer dissipated power outside the panel.
- max. voltage limits and derivative of transients in line, for which the solid state unit has internal protection devices.
- presence of dispersion current < 10mA (max. value with rated voltage and junction temperature of 125°C).

FACEPLATE DESCRIPTION

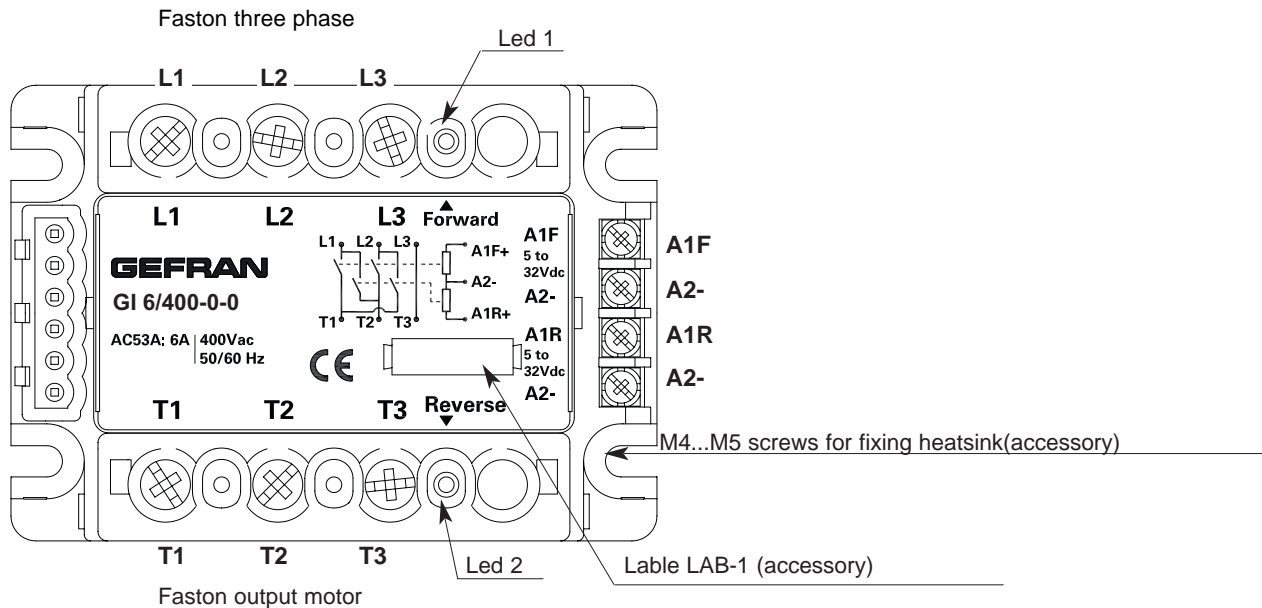

- L1 : Phase 1 input
- L2 : Phase 2 input
- L3 : Phase 3 input
- T1 : Phase 1 output (Motor)
- T2 : Phase 2 output (Motor)
- T3 : Phase 3 output (Motor)
- A1F : Forward run control (+5...32Vdc)
- A1R : Reverse run control (+5...32Vdc)
- A2- : GND run control
- Led1: Green LED indicates forward run ON
- Led2: Red LED indicates reverse run ON


DIMENSIONS

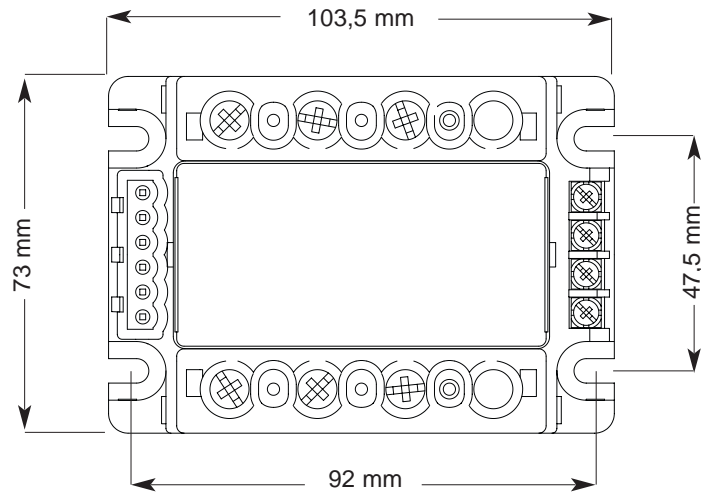

Depth = 43,5 mm
Weight = 300g

TYPE OF OPERATION

Voltage logic output control

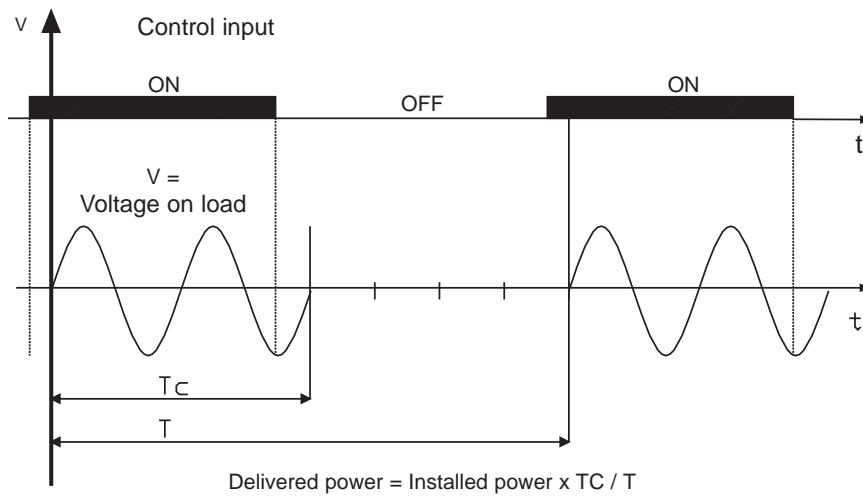

CONNECTION EXAMPLES

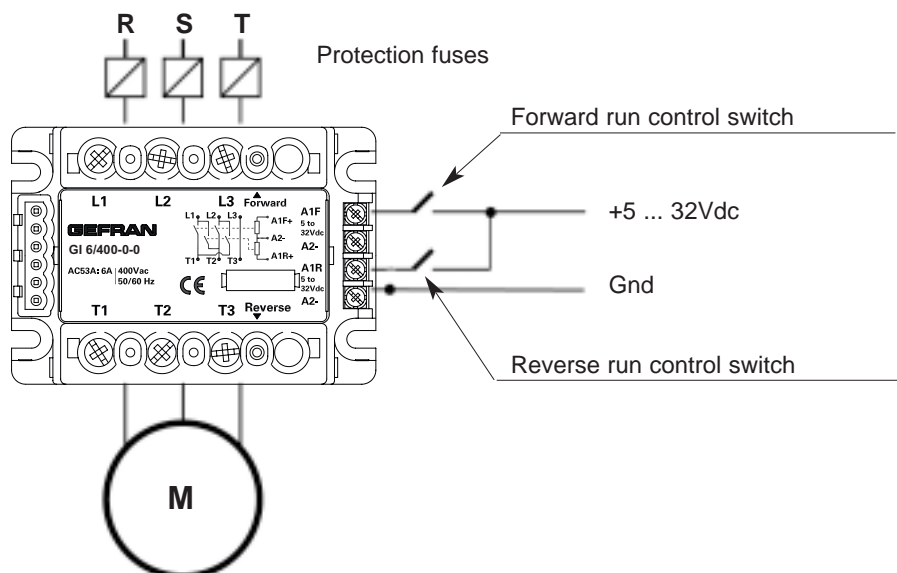


TABLE OF TERMINALS AND CONDUCTORS

Model	Control terminal (A1F, A2-, A1R, A2-)			Power terminal (L1, L2, L3, T1, T2, T3)		
	Contact area (LxP) screw type	Type of preinsulated terminal	Section. * conductor / tightening torque	Contact area (LxP) screw type	Type of preinsulated terminal	Section. * conductor / tightening torque
6A	6,3x9 M3	eye / fork / tip	min. 0.35 mm ² max. 2,5 mm ² 0,6 Nm Max	12x12 M5	occhiello / forcella / puntale	min. 1 mm ² max. 10 mm ² (tip)# min. 1 mm ² max. 16 mm ² (eye/fork) 1,5 - 2,2 Nm

(*) The max. sections specified refer to unipolar copper wires isolated in PVC.

Note: For the ground terminal, you have to use an eye wire terminal.

(LxP) = width x depth [mm]

The minimum acceptable nominal section based on the nominal currents of the power solid state units is given below for copper conductors isolated in PVC, under continuous operating conditions and at 40°C ambient temperature according to standards CEI 44-5, CEI 17-11, IEC 408 in accordance with EN60204-1.


Nominal current	Nominal section cable on mm ²
10A	2,5

Terminal covers

If an eye terminal lug is used, the terminal covers can be removed more easily by inserting a Phillips screwdriver (max. width 3.5 mm) into the side slots.

With the point of the screwdriver, widen the side of the cover and raise it.

Insert the screwdriver to facilitate opening of the cover



PROTECTION FUSES

Only high-speed fuses with $I^2t < 1000 \text{ A}^2\text{s}$ must be used to protect the module.

Choose a fuse current rating that can sustain surge currents when the motor starts.

Available fuses:

Ord. Code	Code	Rating	I ² t
338476	FUS-010	10 A (10x38mm)	70 A ² s
338470	FUS-016	16 A (10x38mm)	150 A ² s
338474	FUS-025	25 A (10x38mm)	390 A ² s
338483	FUS-032	32 A (10x38mm)	600 A ² s

Available fuse holders

Ord. Code	Code	Size
337132	PF-10x38	10x38 mm

EXAMPLE:

Motor: 1.5 KW – 380 V, I_n = 3.5A, the fuse rating is calculated by multiplying rated current by 5, using FUS-025.

REGULATORY REFERENCES

EMC Emission		
EN 60947-4-2	Emissions conducted at radio frequency	Class A (Industrial devices)
EN 60947-4-2	Emission irradiated at radio frequency	Class A (Industrial devices)
EMC Immunity		
EN 61000-4-2	Electrostatic discharges	4kV per contact; 8 kV in air. Performance criterion 2.
EN 61000-4-6	Electromagnetic radio frequency field 0,15-80MHz	Test level 3. Performance criterion 1
EN 61000-4-3	Electromagnetic radio frequency field 80-1000MHz	Test level 10V/m. Performance criterion 1.
EN 61000-4-4	Immunity to bursts	Test level 2kV/5 KHz. Performance criterion 2.
EN 61000-4-5	Immunity to surges	Test level 2kV (Phase-ground); 1kV (Phase-phase). Performance criterion 2.
Security		
EN 61010-1	Safety norms	

ORDER CODE

GI **6** / **400** - **0** - **0**